

Domestic wastewater treatment by using upflow anaerobic sludge blanket reactor

Prof. Dr. Sachin Madhavrao Kanawade

Associate Professor in Chemical Engineering Department, Dr. Vasantraodada Patil Shetkari Shikshan Mandal's Padmabhooshan Vasantraodada Patil Institute of Technology, Budhgaon, Tal - Miraj, Dist - Sangli, Maharashtra, India.

Abstract

This paper presents the findings of the study on treatment of domestic wastewater using a laboratory scale Hybrid Upflow Anaerobic Sludge Blanket (HUASB) reactor. The reactor with a working volume of 5.9 L and plastic cut rings as packing media was operated at varying Hydraulic Retention Time (HRT) for a period of 110 days. While the COD removal varied from 75-86%, the BOD removal was in the range of 70-91%. Methane content in the biogas was 62±3%. VFA levels fluctuating between 100 and 186 mg/L (as acetate) did not pose operational problems such as souring of the reactor. During the treatment, nutrient levels exhibited an increasing trend. HUASB system could be designed with very short HRT of 3.3 hours, which will reduce the treatment cost significantly. It appears to be a promising alternative for the treatment of domestic wastewater in developing countries like India

Keywords: HUASB, domestic wastewater, biogas, treatment efficiency.


1. Introduction

In developing countries like India where access to safe drinking water is not guaranteed for a majority of the population, it is of great importance to maintain the quality of surface water sources. Chennai, one of the four-mega cities in India is the best example for pollution of surface water bodies caused by discharge from sewer outfalls. For instance, Central Pollution Control Board (CPCB) and Ministry of Environment and Forests (MoEF) (2001) [6] have reported that Adyar and Coovum rivers passing through the city receive wastewaters from 141 and 276 sewer outfalls, respectively. At present, there are 6 Sewage Treatment Plants in Maharashtra with an overall treatment capacity of 267 MLD. It is estimated that the domestic wastewater generation in Maharashtra would be of the order of 800 MLD by the year 2021 (CPCB and MoEF, 2001) [6]. This scenario wants an urgent need to develop technologies to treat huge volumes of wastewaters in shortest possible time frame. Advances in anaerobic treatment of domestic wastewater offer a few promising options including Upflow Anaerobic Sludge Blanket (UASB - Heertjes and Van der Meer, 1978; Lettinga and Vinken, 1980; Lettinga, *et al.*, 1980) [13, 16, 17], Anaerobic Filter (AF - Chernicharo and Machado, 1998; Bodik, *et al.*, 2000) [6, 5], Expanded Granular Sludge Bed (EGSB - Van der Last and Lettinga, 1992; Seghezzi, 1997) [30, 25], Anaerobic Baffled Reactor (ABR - Langenhoff and Stuckey, 2000 and Bodik, *et al.*, 2003) [15, 4], Hybrid reactor (HR - Elmitwalli, *et al.*, 2002a and 2002b) [9] and Anaerobic Migrating Blanket Reactor (AMBR - Angenent and Sung, 2001) [3]. It is reported that most of the negative

aspects of high rate anaerobic reactors can be overcome by restricting the supported material to the top 25 to 30% of the reactor volume (Guioand Van den berg, 1984; 1985) [10, 11]. This would help realize the advantages of both fixed film and up flow sludge blanket treatment. This kind of reactor is called Hybrid Upflow Anaerobic Sludge Blanket (HUASB) and is considered more stable for the treatment of a series of soluble or partially soluble wastewaters (Tilche and Vieira, 1991) [29]. Over the years, HUASBs have been used to treat a variety of industrial effluents (Coates and Colleran, 1990; Rajesh, *et al.*, 2006 a, b; Shivayogimath and Ramanujam, 1999) [7, 22, 23, 26]. In the present study, HUASB has been used to treat domestic wastewater.

2. Materials and methods

The laboratory scale HUASB reactor was fabricated using PVC tube with an internal diameter of 11 cm and an overall height of 88 cm (Fig. 1). The working volume of the reactor was 5.9 L. A gas headspace of 1.5 L was maintained above the effluent line. A screen was placed at a height of 60 cm to arrest the floating carrier material – plastic cut rings. One hundred and fifty plastic cut rings were used as carrier material. A peristaltic pump (Make: Miclins, Model: PP 20) was used for feeding wastewater into the reactor. The effluent pipeline in turn was connected to a water seal to prevent the escape of gas. The gas outlet was connected to a wet gas meter (Make: Ritter, Model: TG 05).

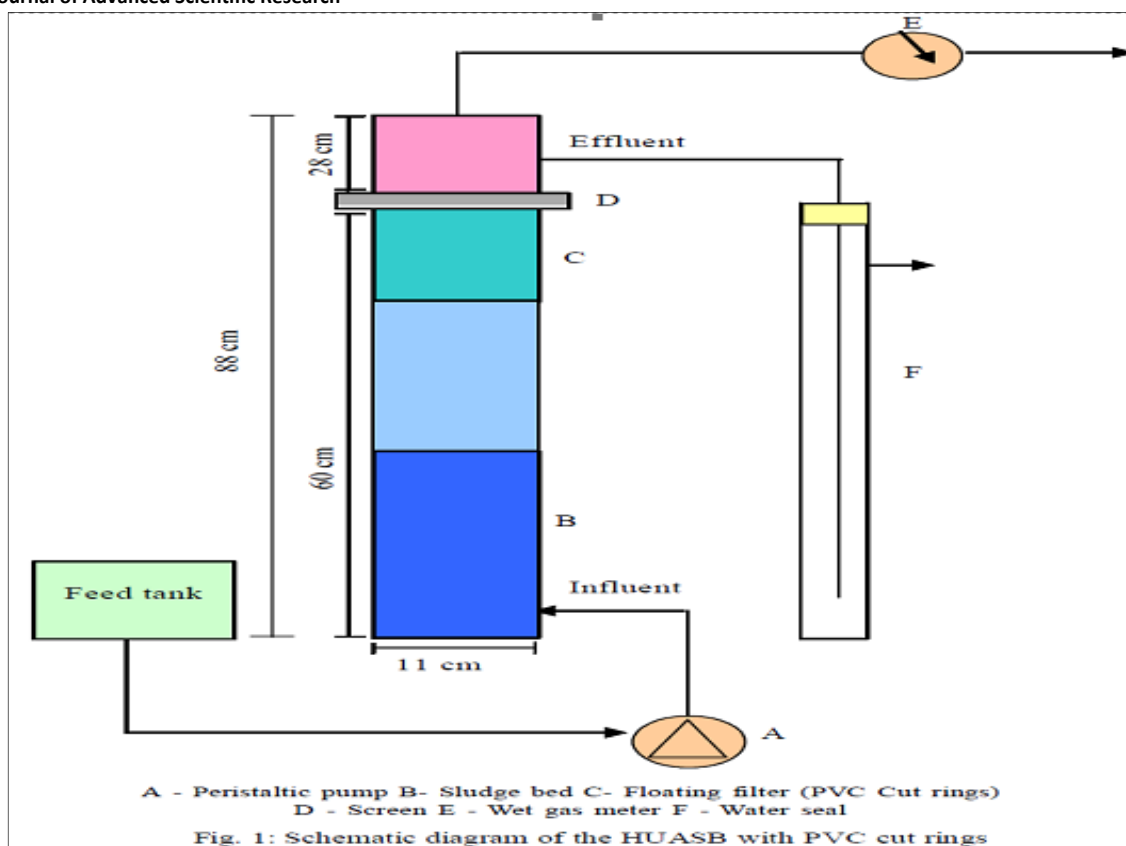

2.1 Wastewater

The domestic wastewater used for the present study was collected from Sewage Treatment Plant, Maharashtra, India.

2.2 Acclimatization

“Start-up” phase of the reactor during the study was not warranted, as the HUASB used was a granulated one. To acclimatize the methanogens to the new substrate, the reactor was operated for a period of 30 days at a HRT of 7.4 hours with domestic wastewater.

2.3 Operational Condition during the Study

The initial HRT was 7.3 h and it was gradually decreased to 3.3 h over a period of 110 days. This was achieved by increasing the flow rate from 800 mL/h to 1800 mL/h.

2.4 Chemical analysis

Chemical Oxygen Demand (COD), Volatile Fatty Acids (VFA), Alkalinity, Total Solids (TS), Volatile solids (VS) and Total Kjeldhal Nitrogen (TKN) of the raw and treated wastewater were analysed following Standard Methods (1998) [27]. Phosphate (PO_4^{3-}), sulphate (SO_4^{2-}) and chloride (Cl^-) were analyzed employing ion exchange chromatography (Make: Dionex, Model: DX-120) after filtering the samples through a $0.45\mu\text{m}$ filter. The eluent was a combination of 3.5 mM bicarbonate and 1 mM carbonate; the flow rate was 1.2 mL/min with an injection volume of $25\mu\text{L}$. Methane content in the biogas was measured by Gas Chromatography (Make: Chemito, Model: GC 1000) equipped with Flame Ionization

Detector (FID). The column used was Proopak Q.

3. Results

Fig. 2 illustrates the influence of Hydraulic retention time (HRT) on pH and biogas production. The pH of the treated wastewater was in the range of 7.4 - 8.1, which is indicative of satisfactory condition of the reactor. It is known that pH value less than 6.8 and greater than 8.3 would cause souring of reactor during anaerobic digestion (Stronach *et al.* 1986; Wheatly, 1991) [28, 33]. The biogas production was in the range of 1800 to 7080 mL/ day. Gas production rates were highly variable due to the fluctuation of organic concentration in the influent. Maximum gas production (7080 mL/day) was recorded at a HRT of 3.3 h. The present values are relatively higher than those reported by earlier workers (Kobayashi, *et al.*, 1982; Ligerio and Soto, 2002) [14, 18]. Higher volumes of biogas recorded during the present study can be attributed to higher concentrations of organic matter present in the wastewater. Methane content in the biogas was $62 \pm 3\%$. This value is comparable to $59 \pm 3.2\%$ reported for gas produced during the treatment of domestic wastewater using anaerobic hybrid reactor (Elmitwalli, *et al.*, 2002a). In contrast to the present observations, Kobayashi *et al.* (1982) has reported very high methane content of 92 % for biogas produced during the treatment of domestic wastewater using anaerobic filter. It is known that gas generated during treatment using anaerobic filter generally has higher methane content as compared to any hybrid reactor (Elmitwalli, 2002b) [9].

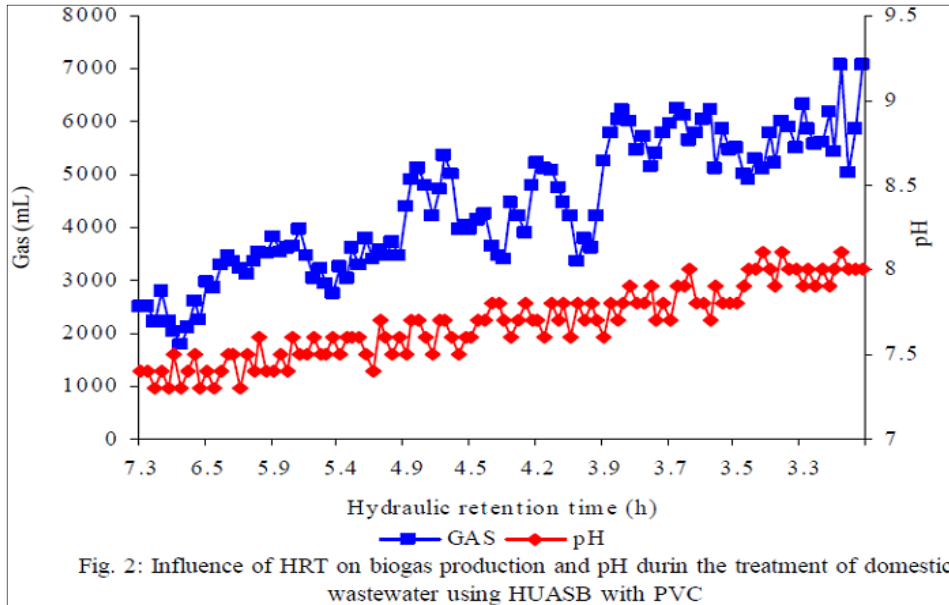


Fig. 3 depicts the influence of HRT on alkalinity and volatile fatty acids (VFA) accumulation in the wastewater during the treatment. Alkalinity of the medium increased from 610 mg/L at a HRT of 7.3 h to 744 mg/L at a HRT of 3.3 h. The alkalinity in the medium was stabilized during the last three operational phases. At different phases, the VFA as acetate in the medium varied from 100 to 165 mg/L. Low VFA levels in anaerobically treated domestic wastewater have been

reported by several workers (Kobayashi, *et al.*, 1982; Ligeró and Soto, 2002; Elmitwalli, *et al.*, 2002a) [14, 18]. VFA has been recognized as one of the important intermediates during the anaerobic digestion (Ahring and Angelidaki, 1997; Wang, *et al.*, 1999) [32] and is considered a central parameter for anaerobic treatment (Ahring and Angelidaki, 1995; Pind, *et al.*, 1999; 2002) [1, 20, 19].

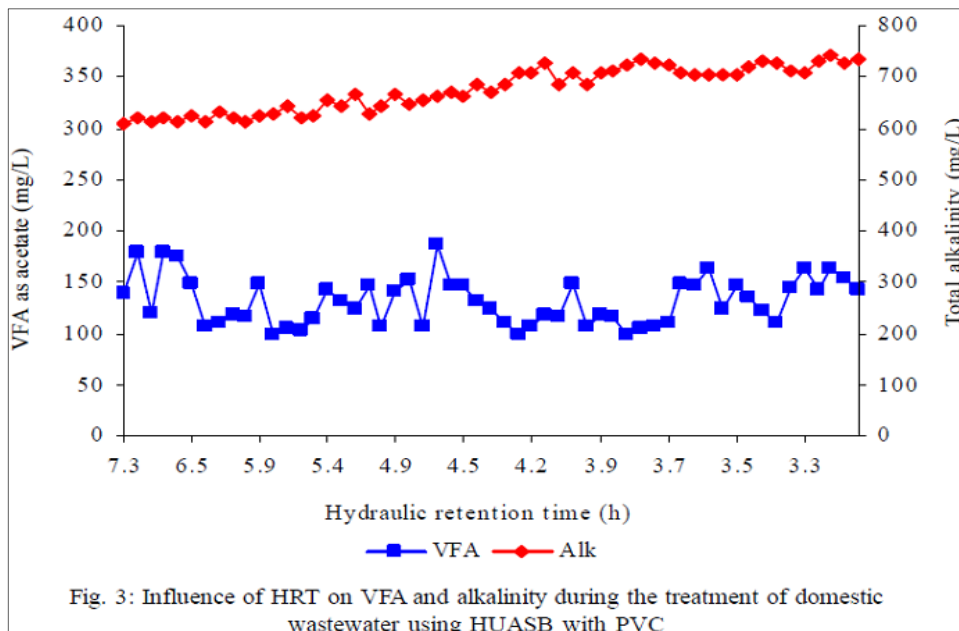


Fig. 4 presents the data on COD removal during different phases of operation. COD removal rate varied from 76 to 86%. Beyond a HRT 3.9 h marginal decrease in COD removal was noticed and the rate varied from 75 to 79% up to a HRT of 3.3

h. The concentration of organics as COD in the raw domestic wastewater varied from 700 - 1368 mg/L and in the treated wastewater it was in the range of 140 - 295 mg/L. As can be seen from

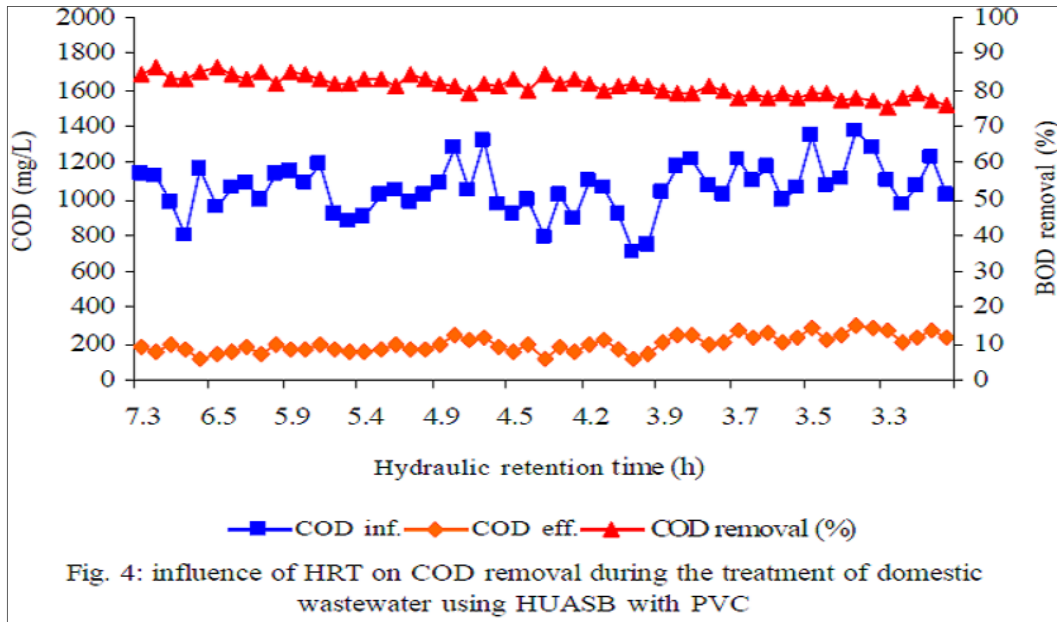


Fig. 5 the BOD removal rate was between 70 and 92 %. This is comparable to 76-88 % BOD removal reported during the treatment of domestic wastewater at a HRT of 4 and 6 h by Chernicharo and Machado (1998) [6]. While the BOD of the influent wastewater varied from 434 - 721 mg/L that of the

treated wastewater was in the range of 47 - 175 mg/L. Increase in HRT beyond 4.5 h caused a gradual decrease in BOD removal. The least BOD removal of 70 % was recorded when the HRT was 3.3 h.

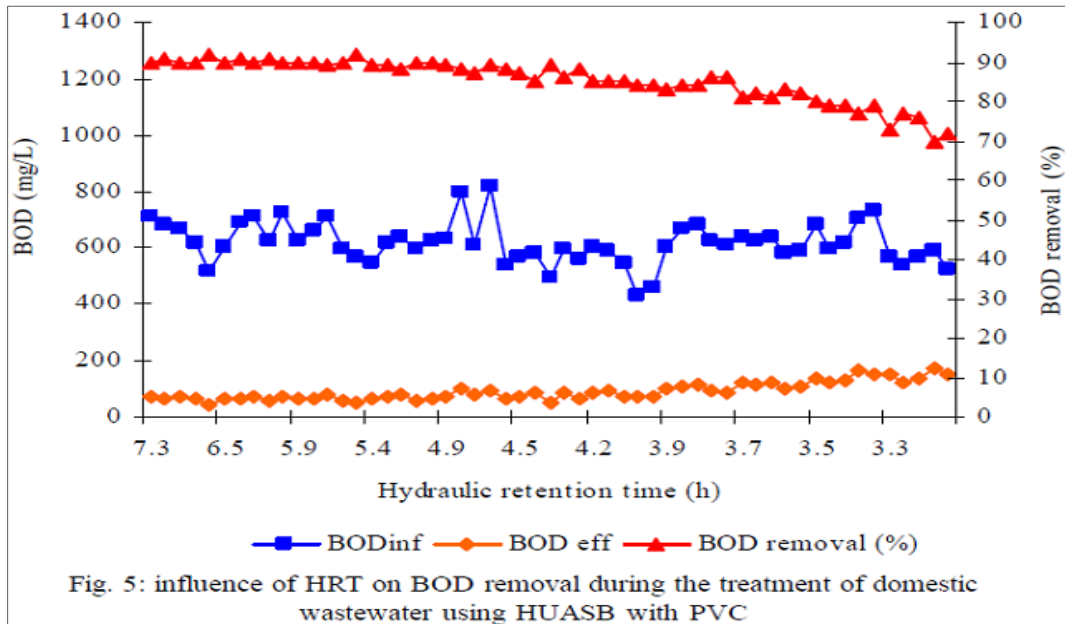


Fig. 6 depicts the influence of OLR on the removal of TS and VS from the wastewater during the study. Removal of TS varied from 30 to 35 % during most of the operational period; the removal was slightly less (28 – 29 %) during the final two HRTs namely 3.5 h to 3.3 h. This may be attributed to the increase in flow rate that applied in the final two HRTs.

Removal of VS varied from 48 to 56 % and as in the case of TS, at higher HRTs the removal efficiency decreased. Determination of VS is useful in the control of wastewater treatment plant operation because it offers rough approximation of the amount of organic matter present in the solid fraction of wastewater (Standard Methods, 1998) [27].

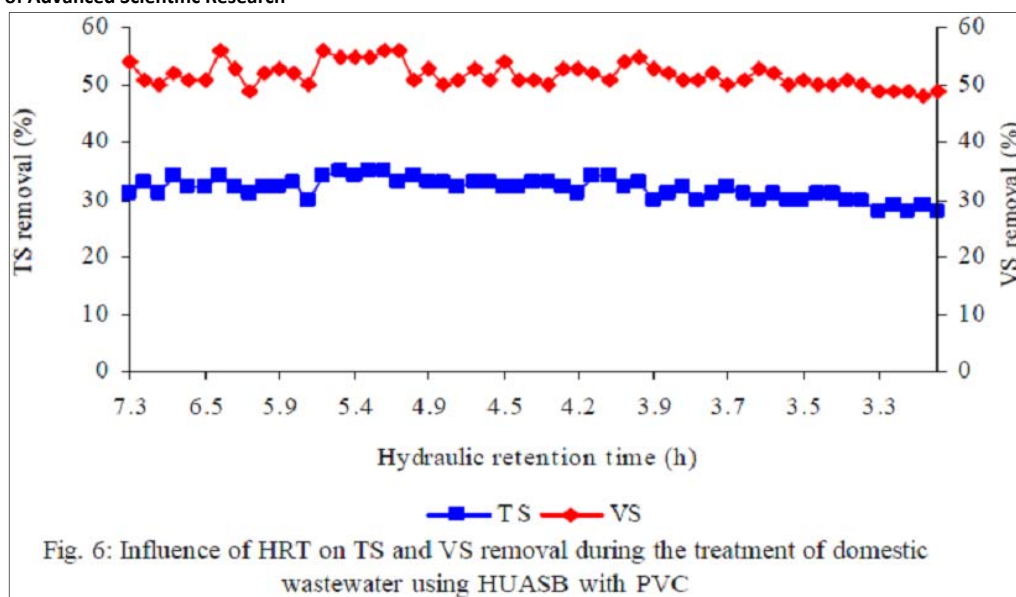


Table 1: presents the characteristics of raw and treated domestic wastewater during the treatment. It is evident from the table that the levels of nitrogen, phosphorus and potassium in the treated wastewater were higher than in raw wastewater. Increase in nutrient levels during the anaerobic treatment of wastewater is a common occurrence and is attributed to the mineralization of organic compounds (Hanndel and Lettinga, 1994). This nutrient rich treated wastewater needs further

treatment, as nitrogen and phosphorus cause algal blooms in receiving water bodies. Ammonia concentration in the wastewater during all the phases of operation increased as a result of ammonification. The removal of sulphate from the wastewater during the treatment was significant. The chloride concentration in the effluent remained unaffected during the treatment.

Parameter	Concentration influent (mg/L)	Effluent
TKN	43.4-49.0	47-53.2
NH3-N	23-28.5	42-48.1
Chloride	160-188	160-188
Sulphate	39-56	15-24
Phosphate	14.8-16.6	16.2-19.1
Potassium	13.5-17.1	14.1-18

4. Conclusion

Anaerobic treatment of domestic wastewater employing HUASB efficiently removed organics both COD and BOD with in very short period of time. Comparatively lower organics removal efficiencies during the treatment of domestic wastewaters using UASB at different HRTs have been reported by several workers (65% at a HRT of 4 h - Haskoning, 1989; 53% at a HRT of 4.4 h - Viera and Garcia, 1991; 72% at a HRT of 5 h - Schellinkhout and Callazos, 1991) [12, 31, 24]. The commonl encountered problem of VFA induced ‘souring’ of the reactor was not encountered during the present study as the VFA levels were quite low. Interestingly, the alkalinity in the medium was also low indicating the fact that buffering effect of alkalinity was not warranted. In a critique on the functioning of

anaerobic reactors Hanndel and Lettinga (1994) [12] have also opined that VFA accumulation does not “sour” the reactor during the treatment of domestic wastewater and pH correction therefore is not essential. The reduction in COD and BOD removal efficiency at higher HRT may be attributed to higher upflow velocity of the wastewater and the consequent reduction in contact time between organics in the wastewater and microbes. Results obtained in the present study demonstrate that HUASB with PVC can promote enhanced COD and BOD removal from domestic wastewater. HUASB system can be effectively used for the treatment of domestic waste in developing countries like India, since the system can be designed with relatively short HRT. Further, the biogas generated during the process adds attraction as it can be used as

a fuel. Similarly, studies on starvation and shock loading would help evaluate the process and its application, paving way for pilot plant experiments. Work on these aspects is in progress.

5. Acknowledgement

I am gratefully acknowledgements to my family & friends for their guidance & help in completion of this paper.

6. References

1. Ahring BK, Angelidaki I. Volatile fatty acids as indicators of process imbalance in anaerobic digestion. *Appl. Microbiol. Biotechnol* 1995; 43:559-565.
2. Ahring BK, Angelidaki I. Monitoring and controlling the biogas process. Proceeding at 8th. International conference on anaerobic digestion. Sendai, Japan, 1991, 40-45.
3. Angenent LT. Rating blanket reactor (AMBR), a novel anaerobic treatment system. *Wat. Res.* 2001; 35:1739-1747.
4. Bodik I, Kratochvil K, Gaspirkova Hutnan M. Nitrogen removal in an anaerobic baffled filter reactor with aerobic post treatment. *Biores. Technol* 2003; 86:79-82.
5. Bodik L, Herdova B, Kratochvil K. The application of anaerobic filter for municipal wastewater treatment. Proceedings of the 20th. International conference of the Slovak society of chemical engineering. 2000; 54(3):159-164.
6. CPCBMo EF. Environmental improvement of waterways in Chennai-Report. Ministry of Environment and Forest, India. Chernicharo CAL, Machado RMG. 1998 Feasibility of UASB/AF system for domestic sewage treatment in developing countries. *Wat. Sci. Tech* 2001; 38:325-333.
7. Coates J, Colleran E. Effect of initial agitation on the startup and operational performance of anaerobic hybrid reactors treating a synthetic feed. *Process Biochem* 1990; 10:162-171.
8. Elmitwalli TA, Sklyar V, Zeeman G, Lettinga G. Low temperature pretreatment of domestic sewage in an anaerobic hybrid or an anaerobic filter reactor. *Biores. Technol* 2000a; 52:233-239.
9. Elmitwalli TA, Kim LT, Oahan Zeeman G, Lettinga G. Treatment of domestic sewage in a tow step anaerobic filter/anaerobic hybrid system at low temperature. *Wat Res* 2002b; 36:2225-2232.
10. Guiot SR, Van den Berg L. Dynamic performance of an anaerobic reactor combining an upflow sludge blanket and a filter for the treatment of sugar waste. Proceedings of the 39th annual Purdue Industrial Waste Conference. Lafayette, 1984, 705-717.
11. Guiot SR, Van den Berg L. Performance of an upflow anaerobic reactor combining a sludge blanket and a filter treating sugar waste. *Biotechnol and Bioeng* 1985; 27:800-806.
12. Hanndel VCA, Lettinga G. Anaerobic sewage treatment- a practical guide for regions with a hot climate. Willey publisher, England. Haskoning. Anaerobic treatment of domestic wastewater under tropical conditions – Final report. Royal Dutch Consulting Engineers and Architects, 1994-1989.
13. Heertjes PM, Van der Meer RR. Dynamics of liquid flow in an upflow reactor used for anaerobic treatment of wastewater. *Biotechnol. Bioeng* 1978; 20:1577-1594.
14. Kobayashi HA, Stenstrom MK, Mah RA. Treatment of low strength wastewater using the anaerobic filter. *Water Res* 1982; 17(18):903-909.
15. Langenhoff AM, Stucky DC. Treatment of dilute wastewater using an anaerobic baffled reactor: Effect of low temperature. *Water Res* 2000; 34(15):3867-3875.
16. Lettinga G, Vinken JN. Feasibility of the upflow anaerobic sludge blanket (UASB) process for the treatment of low strength water. Proceedings of the 35th Purdue industrial waste conference, 1980, 625-634.
17. Lettinga G, Van Nelsen AFH, Hobma SW, De Zeeu WW, Klapwijk A. Use of the upflow sludge (USB) reactor concept for biological wastewater treatment, especially for anaerobic treatment. *Biotech. Bioeng* 1980; 25:1701-1723.
18. Ligerio P, Soto M. Sludge granulation during anaerobic treatment of pre-hydrolyzed domestic wastewater. *Water SA* 2002; 28(3):307-311.
19. Pind PF, Angelidaki I, Ahring BK. Dynamics of the anaerobic process: Effects of volatile fatty acids. *Biotech. Bioeng* 2002; 82(7):791-801.
20. Pind PF, Angelidaki I, Ahring BK. The use of VFA measurement as process indicators in anaerobic reactors treating manure. Proceedings of the II international symposium on anaerobic digestion of solid waste. Barcelona, 1999, 41-44.
21. Rajesh banu J, Kaliappan S, Diter Beck. Treatment of sago wastewater in hybrid anaerobic reactor. *Water Qual. Res. J Canada.* 2006a; 41:56-62.
22. Rajesh banu J, Kaliappan S, Diter Beck. High rate anaerobic treatment of Sago wastewater using HUASB with PUF as carrier. *Int. J Environ. Sci. Tech.* 2006b; 3(1):73-81.
23. Schellinkhout A, Collazos CJ. Full scale application of the UASB technology for sewage treatment. Proceedings of the 6th International IAWPRC symposium. Sao Paulo, Brazil, 1991.
24. Seghezze L. Kinetics and structure of anaerobic granular sludge from EGSB reactors. M.Sc thesis. Wageningen Agricultural University, Wageningen, the Netherlands, 1997.
25. Shivayogimath CB, Ramanujam TK. Treatment of distillery spent wash by hybrid UASB reactor. *Bioprocess Engineering* 1999; 21:255-259.
26. Standard Methods. Standard Methods for the Examination of Water and Wastewaters. APHA, Washington D.C., 1998.
27. Stronach SM, Rudd T, Lester JN. Anaerobic digestion process in the industrial wastewater treatment. Springer-Verlag, Berlin, Germany, 1986.
28. Tilche A, Vieira SMM. Discussion report on reactor design of anaerobic filters and sludge bed reactors. *Water Sci. Tech* 1991; 24:193-206.
29. Van der Last ARM, Lettinga G. Anaerobic treatment of domestic sewage under moderate climatic (Dutch)

International Journal of Advanced Scientific Research

- conditions using upflow reactors at increased superficial velocities. *Water Sci. Tech* 1992; 25:167-178.
30. Viera SMM, Garcia AD. Sewage treatment by UASB reactor, operation results and recommendations for design and utilization. Presented at the 6th. International IAWPRC Symposium. Sao Paulo, Brazil, 1991.
 31. Wang QH, Kuninobu M, Ogawa HI, Kato Y. Degradation of volatile fatty acids in highly efficient anaerobic digestion. *Biomass Bioenergy* 1999; 16:407-416.
 32. Wheatley A. Anaerobic digestion: A waste treatment technology. Elsevier Science publishers Ltd, U.K., 1991.

Biography



Dr. Sachin Madhavrao Kanawade was born in 11 March 1978 at Nashik, Maharashtra, India. His native place is Nimgaonpaga, Tal-Sangamneer, Dist-A'Nagar, Maharashtra, India. He received his Bachelor's Degree in Chemical Engineering from Pravara Rural Education Society's Pravara Rural Engineering College, Pravaranagar (Loni) which is affiliated to Pune University in India in Nov.2001. Then he worked as a Production Officer in different Multinational Chemical Industries in India (2001 to 2008) like M/S Watson Pharma Ltd, Ambarnath, MIDC, Mumbai, MS, M/S Glenmark Pharmaceuticals Ltd, Mohol, Dist. Solapur, MS, M/S Sun Pharmaceutical Industries Ltd, A. Nagar, MIDC, MS for 7 years.

Then he changes his field. He joined K.K. Wagh College, Nashik, MS, India in 2008 & worked as Lecturer for 2 years. At the same time he received his Master of Engineering in Environmental Engineering from Pravara Rural Education Society's Pravara Rural Engineering College, Loni in Dec.2010. Then he joined Pravara Rural Education Society's Sir Visvesvaraya Institute of Technology, Chincholi, Tal-Sinnar, Dist-Nasik, MS. India in 2010 & worked as Assistant Professor in Chemical Engineering Department for 5 years.

In the same period he completed his PhD Degree in Chemical Engineering in session 2011 – 2014 from Kumar BhaskarVarma Sanskrit and Ancient Studies University Nalbari, Assam, India. In 2016 he completed his Post Doctorate in Chemical Engineering from New World Mission Dunamis International University, South Africa.

Presently he is an Associate Professor at Dr. Vasantodada Patil Shetkari Shikshan Mandal's Padmabhooshan Vasantodada Patil Institute of Technology, Budhgaon, Tal – Miraj, Dist– Sangli, Maharashtra, India in Chemical Engineering Department. Presently he is Reviewer / Editorial Board Member/Advisory Board Member of 64 different International Journals of different fields. He has 21 International Professional Membership of different Organizations. He published 62 Technical Research Papers in

different International Journals like International Journal of Wastewater Treatment & Green Chemistry, International Journal of Chemical Engineering, International Journal of Environmental Pollution Control & Management, International Journal of Multidisciplinary Approach & Studies, International Journal of Chemical Engineering & Applications, International Journal of Chemistry & Material Science & International Journal of Engineering Studies and Technical Approach etc. His research topic includes & interested in Chemical Engineering, Environmental Engineering, Wastewater Treatment by Adsorption, Advanced Separation Process, Chemical Engineering Design, Mass Transfer, Chemical Process Synthesis, Chemical Engineering Thermodynamics etc.